

FUZZY LOGIC BASED ON LYAPUNOV SOLUTION IN POWER SYSTEM STABILITY IMPROVEMENT

by Tamaji Tamaji

Submission date: 07-Feb-2019 12:11AM (UTC-0500)

Submission ID: 1074331327

File name: D_ON_LYAPUNOV_SOLUTION_IN_POWER_SYSTEM_STABILITY_IMPROVEMENT.pdf (415.34K)

Word count: 717

Character count: 2271

Fuzzy Logic Based on Lyapunov Solution in Power System Stability Improvement

Tamaji and Imam Robandi

Department of Electrical Engineering, Sepuluh Nopember Institute of Technology,
Surabaya, Indonesia

Abstract: There are many methods to design controller of power system. In this study, we design the controller of generator power system to stabilize the electricity supply. The system is assumed the single machine infinite bus. The mathematical model of power system stabilizer is non-linear. The first time, the system is written in the state space system, then it is designed the output feedback controller by using Lyapunov and fuzzy Lyapunov method, finally the performance of SMIB by Lyapunov and fuzzy Lyapunov method are compared with the performance by using pole placement and routh-hurwitz method. The simulation has been done with some parameters feedback gain such as the feedback gain K , K_{fuzzy} , K_{pole} , K_{RH} based on Lyapunov, fuzzy Lyapunov, fuzzy pole placement and fuzzy Routh-Hurwitz method, respectively. Based on our simulation we know that Lyapunov and fuzzy Lyapunov have almost same performance and have the best performance compared with fuzzy pole placement and fuzzy Routh-Hurwitz.

Key words: Single machine infinite bus, output feedback controller, Lyapunov, fuzzy Lyapunov function, fuzzy pole placement, fuzzy Routh-Hurwitz

INTRODUCTION

There are some methods to design the controller of system such as state feedback controller, output feedback controller, sliding mode control-SMC and others. Here, we design the controller of generator power systems. The stability of generator power system is necessary to keep the stability of electricity supply. The mathematical model of Power System Stabilizer-PSS is Single Machine Infinite Bus (SMIB). This mathematical model is a non linear system. There are many methods to design the controller of PSS such as improved swarm optimization to stabilize the SMIB (Alfi and Khosravi, 2012), the robust control PSS based on pole placement and Linear Matrix Inequality-LMI (Ataei *et al.*, 2012; Challoshtori, 2012), direct feedback linearization is applied to design the controller for SMIB (Yadaiah and Romana, 2007). Some researchers applied the design control methods in linear system. Here, it is designed the controller for non-linear system.

The non linear system of SMIB is unstable so, it is necessary to design the controller. In this study, the output feedback controller of SMIB is design by constructing the Lyapunov function. The Lyapunov function is a part of LMI method. Some researchers have been used LMI to design the controller of SMIB such as Mondal (2012): the Linear Matrix Inequality (LMI) has been applied to design an internally stabilizing controller

for the TCSC that satisfy H_{∞} norm constraint. Fuzzy logic controller is applied to enhance the stability of SMIB (Sedaghati *et al.*, 2014; Jasmitha and Vijayasanthi, 2015) and power system stability is enhanced through a novel stabilizer developed around an adaptive fuzzy sliding mode approach which applies the Nussbaum gain to a non-linear model of a Single-Machine Infinite-Bus (SMIB) (Nechad *et al.*, 2013). Actually, in LMI method, we also construct the Lyapunov function $V(x, t)$ as energy of system is positive and the velocity $dV(x, t)/dt < 0$. They used the LMI toolbox and applied in linear system. In this study, it is constructed the Lyapunov function by analytical method and retained the SMIB system as non linear system. The SMIB system is written as state space system and the feedback gain is determined based on Lyapunov method. In this study, it is also applied the fuzzy Lyapunov method. The fuzzification is applied in the state space system, the output feedback gain is determined by Lyapunov and finally it is applied defuzzification to get stabilize SMIB system.

The performance of SMIB system by Lyapunov and Fuzzy Lyapunov method are compared with the other methods of design controller such as fuzzy pole placement and fuzzy Routh-Hurwitz.

SMIB performancy: Single machine infinite bus of the generator power system can be modeled as non-linear model (Yadaiah and Romana, 2007).

Corresponding Author: Tamaji, Department of Electrical Engineering, Sepuluh Nopember Institute of Technology, Surabaya, Indonesia

$$\dot{\delta} = \omega_0 \omega \quad (1)$$

$$\dot{\omega} = (T_m - E'_q I_q - (x_q - x'_d) I_d I_q) / M \quad (2)$$

$$\dot{E}'_q = (-E'_q - (x_q - x'_d) I_d + E'_{fd}) / T'_{d0} \quad (3)$$

$$\dot{E}'_{fd} = \frac{K_E}{T_E} (V_{ref} - V_T + u_{ps}) - \frac{1}{T_E} E'_{fd} \quad (4)$$

Where:

$$V_T = \sqrt{V_d^2 + V_q^2}$$

$$V_d = -X_c I_q + V_s \sin \delta$$

$$V_q = X_c I_q + V_s \cos \delta$$

$$P = \frac{E'_q V_s}{X_{dc}} \sin \delta$$

$$Q = \frac{E'_q V_s}{X_{dc}} \cos \delta - \frac{V_s^2}{X_{dc}}$$

The state variable δ , ω , E'_q , E'_{fd} is angle, angular velocity, induced EMF proportional to field current and generator field voltages, respectively. The non-linear system of SMIB (Eq. 1-4) is unstable and the performance of system is presented on Fig. 1. It is necessary to design the controller to obtain the stable system. In this study, it

is design the controller by constructing the Lyapunov function and fuzzy Lyapunov function. The first time, it is proposed the state space system as below:

$$\begin{bmatrix} \dot{\delta} \\ \dot{\omega} \\ \dot{E}'_q \\ \dot{E}'_{fd} \end{bmatrix} = \begin{bmatrix} 0 & \omega_0 & 0 & 0 \\ 0 & a & -b & 0 \\ 0 & 0 & -c & \frac{1}{T'_0} \\ 0 & 0 & d & -\frac{1}{T_E} \end{bmatrix} \begin{bmatrix} \delta \\ \omega \\ E'_q \\ E'_{fd} \end{bmatrix} + \begin{bmatrix} 0 \\ 0 \\ 0 \\ \frac{K_E}{T_E} \end{bmatrix} u_{ps} \quad (5)$$

Where:

$$a = \frac{(T_m - (x_q - x'_d) I_d I_q)}{M \omega}$$

$$b = \left[\frac{P x'_{dc} - V_d}{E'_q X_c M - X_c M} \right]$$

$$c = \left(\frac{1}{T'_{d0}} + \frac{(x_d - x'_d) I_d}{T'_{d0} E'_q} \right)$$

$$d = \frac{K_E}{T_E E'_q} (V_{ref} - V_T)$$

The state space system in Eq. 5 can be written as general model of system as follows:

$$\dot{X} = AX + Bu \quad (6)$$

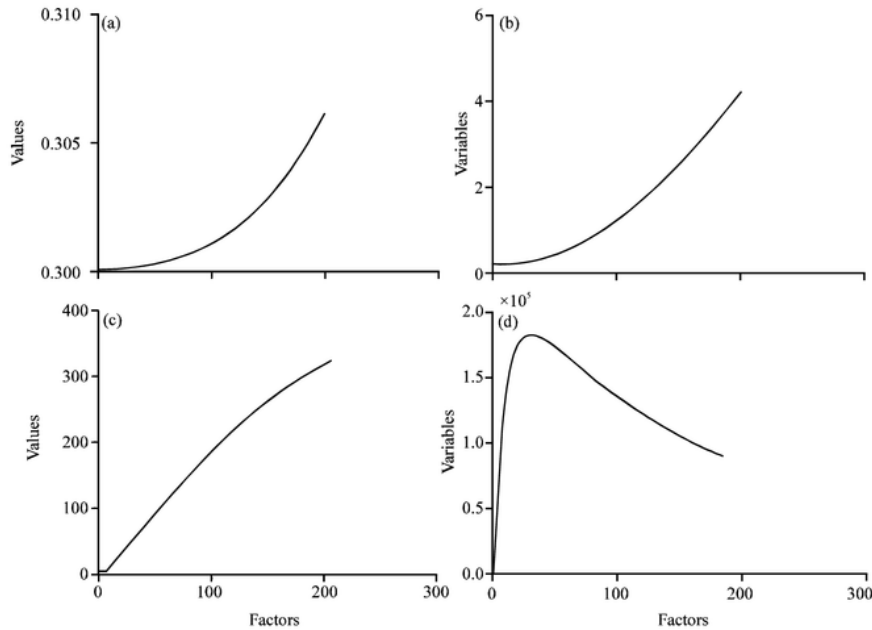


Fig. 1: SMIB performance without control: a) Delta; b) Omega; c) E_q and d) E'_{fd}

With output Eq. 7:

$$y = CX \quad (7)$$

Where:

$$X = [\delta \quad \omega \quad E_q \quad E_{\beta}]^T$$

$$A = \begin{bmatrix} 0 & \omega_0 & 0 & 0 \\ 0 & a & -b & 0 \\ 0 & 0 & -c & \frac{1}{T_0} \\ 0 & 0 & d & -\frac{1}{T_E} \end{bmatrix} \quad B = \begin{bmatrix} 0 \\ 0 \\ 0 \\ \frac{K_E}{T_E} \end{bmatrix}$$

$$C = [0 \quad 1 \quad 0 \quad 0]$$

MATERIALS AND METHODS

Fuzzy logic based on Lyapunov: In this research, it is designed the output feedback controller. In output feedback controller, it is determined the output feedback gain K in control, $u = -Ky$ such that system:

$$\dot{X} = AX - BKy$$

Or:

$$\dot{X} = (A - BKC)X \quad (8)$$

is stable. There are some methods to determine the feedback gain K in feedback controller problem such as pole placement, Ruth-Hurwitz method, fuzzy control and lmi methods. Here, it is used the lmi method or Lyapunov method.

The Lyapunov output feedback controller: Control system design by LMI method, actually, it is constructed the Lyapunov function $V(x, t)$ such that:

$$V(x, t) \geq 0; V(0, 0) = 0$$

$$\frac{dV}{dt}(x, t) < 0$$

It is chosen the Lyapunov function $V(x, t) = x^T R x$ where, R is symmetry definite positive matrix:

$$\frac{dV}{dt} = \dot{V}(x, t) = \dot{x}^T R x + x^T R \dot{x} \quad (9)$$

Substitute Eq. 8 into Eq. 9, it is obtained:

$$\dot{V}(x, t) = x^T \left((A - BKC)^T R + R(A - BKC) \right) x \quad (10)$$

Equation 8 is stable if $\dot{V}(x, t) < 0$. So, the problem of control design by Lyapunov method is, how determine the output feedback gain K and matrix symmetry R in

Eq. 10 such that matrix $(A - BKC)^T R + R(A - BKC)$ definite negative. Suppose R semi definite positive matrix:

$$R = \begin{bmatrix} r_{11} & 0 & 0 & 0 \\ 0 & r_{22} & 0 & 0 \\ 0 & 0 & r_{33} & 0 \\ 0 & 0 & 0 & r_{44} \end{bmatrix}$$

where, $r_i > 0, i = 1, 2, 3, 4$. Then:

$$(R(A - BKC))^T + R(A - BKC) =$$

$$\begin{bmatrix} 0 & r_{11}\omega_0 & 0 & 0 \\ r_{11}\omega_0 & 2r_{22}a & -r_{22}b & \frac{K_E}{T_E} Kr_{44} \\ 0 & -r_{22}b & -2r_{33}c & r_{44}d + \frac{1}{T_0} r_{33} \\ 0 & \frac{K_E}{T_E} Kr_{44} & r_{44}d + \frac{1}{T_0} r_{33} & -2r_{44} \frac{1}{T_E} \end{bmatrix}$$

Then:

$$\frac{dV}{dt} = 2r_{11}\omega_0\omega\delta + 2r_{22}a\omega^2 - 2r_{22}bE_q\omega + 2\frac{K_E}{T_E}Kr_{44}E_{\beta}\omega -$$

$$2r_{33}cE_q^2 + 2r_{44}dE_{\beta}E_q + \frac{2}{T_0}r_{33}E_{\beta}E_q + -2r_{44}\frac{1}{T_E}E_{\beta}^2$$

So, the SMIB system will be stable if:

$$2r_{11}\omega_0\omega\delta + 2r_{22}a\omega^2 - 2r_{22}bE_q\omega + 2\frac{K_E}{T_E}Kr_{44}E_{\beta}\omega -$$

$$2r_{33}cE_q^2 + 2r_{44}dE_{\beta}E_q + \frac{2}{T_0}r_{33}E_{\beta}E_q - 2r_{44}\frac{1}{T_E}E_{\beta}^2 < 0$$

Or:

$$\begin{bmatrix} r_{11} \\ r_{22} \\ r_{33} \\ r_{44} \end{bmatrix}^T \text{diag} \left(\begin{matrix} \omega_0\omega, a\omega - bE_q, \frac{1}{T_0}E_{\beta} - cE_q, \\ \frac{K_E}{T_E}K\omega + dE_q - \frac{1}{T_E}E_{\beta} \end{matrix} \right) \begin{bmatrix} \delta \\ \omega \\ E_q \\ E_{\beta} \end{bmatrix} < 0$$

Because $r_{11}, r_{22}, r_{33}, r_{44}$ positive and variables $\delta, \omega, E_q, E_{\beta}$ also positive then:

$$(a\omega - bE_q) < 0; \left(\frac{1}{T_0}E_{\beta} - cE_q \right) < 0$$

$$\left(\frac{K_E}{T_E}K\omega + dE_q - \frac{1}{T_E}E_{\beta} \right) < 0$$

So:

$$\left(\frac{K_E}{T_E}K\omega + dE_q - \frac{1}{T_E}E_{\beta} \right) < 0 \rightarrow K < \left(\frac{1}{T_E}E_{\beta} - dE_q \right) \frac{T_E}{\omega K_E}$$

and r_{44} larger than r_{11} , r_{22} , r_{33} . The output feedback gain of SMIB by using Lyapunov function is:

$$K < \left(\frac{1}{T_E} E_{\text{fit}} - dE_q \right) \frac{T_E}{\omega K_E}$$

The output feedback gain is depend on variables ω , E_q and E_{fit} . It can be chosen:

$$K = \beta \left(\frac{1}{T_E} E_{\text{fit}} - dE_q \right) \frac{T_E}{\omega K_E}; 0 < \beta < 1 \quad (11)$$

As output feedback gain and substituted Eq. 11-8 so that system SMIB stable. Here is also applied the fuzzy controller to design the controller of SMIB and we call Fuzzy Lyapunov output feedback controller.

Fuzzy Lyapunov output feedback controller: In this research, it applied the fuzzy controller to avoid the non linearity of SMIB system. It is chosen the fuzzy parameters, P, Q, X_e . The interval of parameters are $P \in [P^- P^+]$; $Q \in [Q^- Q^+]$ and $X_e \in [X_e^- X_e^+]$. Suppose $P \in [0.4 1]$; $Q \in [-0.2 0.5]$ and $X_e \in [0.2 0.4]$ then the members function of P, Q, X_e can be described in Fig. 2. There are three parameters, so that there are 8 rules of SMIB system (Tanaka and Wang, 2001).

Rule 1:

If... $P(t)$ is... P^- and... $Q(t)$ is... Q^- and... $X_e(t)$ is... X_e^-
 Then
 $\dot{x}(t) = A_1 x(t) + Bu(t)$
 $y(t) = Cx(t)$

Rule 2:

If... $P(t)$ is... P^+ and... $Q(t)$ is... Q^- and... $X_e(t)$ is... X_e^+
 Then
 $\dot{x}(t) = A_2 x(t) + Bu(t)$
 $y(t) = Cx(t)$

...
 ...
 ...

Rule 8:

If... $P(t)$ is... P^+ and... $Q(t)$ is... Q^+ and... $X_e(t)$ is... X_e^+
 Then
 $\dot{x}(t) = A_8 x(t) + Bu(t)$
 $y(t) = Cx(t)$

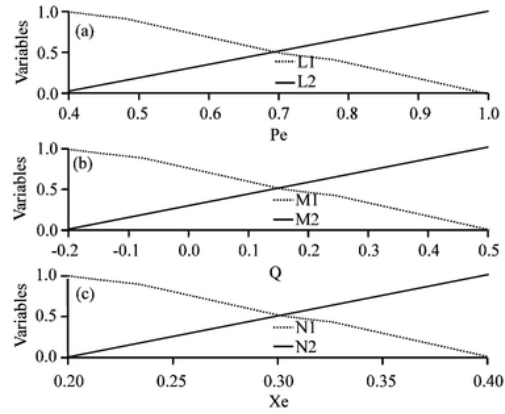


Fig. 2: Members function of Pe, Q, X_e

The Lyapunov output feedback controller is applied for each rule and obtained the Lyapunov output feedback gain K_i , $i = 1, 2, 3, \dots, 8$. From Eq. 11, the feedback gain is:

$$K_i < \left(\frac{1}{T_E} E_{\text{fit}}^i - dE_q^i \right) \frac{T_E}{\omega K_E}; i = 1, 2, 3, \dots, 8$$

and such as in Lyapunov output feedback controller, it can be chosen:

$$K_i = \beta \left(\frac{1}{T_E} E_{\text{fit}}^i - dE_q^i \right) \frac{T_E}{\omega K_E} \quad (12)$$

for $i = 1, 2, 3, \dots, 8$ and $0 < \beta < 1$. By substituting the feedback gain K_i Eq. 12 in to SMIB system Eq. 8, it is obtained the eight of systems. Suppose, the member functions of P, Q and X_e as follows:

$$L_1 = \frac{P - P^-}{P^+ - P^-}; L_2 = \frac{P^+ - P}{P^+ - P^-}$$

$$M_1 = \frac{Q - Q^-}{Q^+ - Q^-}; M_2 = \frac{Q^+ - Q}{Q^+ - Q^-}$$

$$N_1 = \frac{X_e - X_e^-}{X_e^+ - X_e^-}; N_2 = \frac{X_e^+ - X_e}{X_e^+ - X_e^-}$$

And:

$$h_1 = L_1 M_1 N_1; h_2 = L_1 M_1 N_2; h_3 = L_2 M_1 N_1; h_4 = L_2 M_1 N_2;$$

$$h_5 = L_1 M_2 N_1; h_6 = L_1 M_2 N_2; h_7 = L_2 M_2 N_1; h_8 = L_2 M_2 N_2$$

Then, the state space Eq. 8 can be written as a fuzzy model:

$$\dot{x} = \sum_{i=1}^8 h_i (A_i - BK_i C) x_i \quad (13)$$

Some simulation of the SMIB's performance are made based on Eq. 12 and 13.

RESULTS AND DISCUSSION

In this simulation we take some parameters from (Yadaiah and Romana, 2007), $\omega_0 = 0.2$; $T_m = 8$; $x'_q = 1.2$; $x_d = 1.8$; $M = 13$; $K_E = 20$; $T_E = 0.001$; $T'_{d0} = 8$ with initial conditions $\delta = 0.3$; $\omega = 0.2$; $E_q = 0.2$ and $E_{fd} = 0.1$. It has been done also the others output feedback design controller such as pole placement, routh-hurwitz, fuzzy pole placement and fuzzy Routh-Hurwitz methods in (Tamaji and Robandi, 2017). From references (Tamaji and Robandi, 2017) the output feedback gain by pole placement:

$$K_{polc} = \left(\lambda_1 \lambda_2 \lambda_3 + a \frac{d}{T_0} - ac \frac{1}{T_E} \right) \frac{T_0 T_E}{b K_E}$$

Where:

$$\lambda_2 = -\alpha \left(c + \frac{1}{T_E} - a \right) \quad 0 < \alpha < 1$$

$$\lambda_1 = -\frac{1}{2} \left(c + \frac{1}{T_E} - a + \lambda_2 \right) \pm$$

$$\frac{1}{2} \sqrt{\left(c + \frac{1}{T_E} - a + \lambda_2 \right)^2 - 4 \left(\lambda_2^2 + \left(c + \frac{1}{T_E} - a \right) \lambda_2 + \left(\frac{c}{T_E} - \frac{d}{T_0} - ca - \frac{a}{T_E} \right) \right)}$$

$$\lambda_3 = -\left(c + \frac{1}{T_E} - a + \lambda_1 + \lambda_2 \right)$$

The output feedback gain of Routh-Hurwitz:

$$K_{RH} = \beta \left(a \frac{d}{T_0} - ac \frac{1}{T_E} \right) \frac{T_E T_0}{b K_E}; \quad 0 < \beta < 1$$

Based on those feedback gains, it has been done some simulation to get the performance of SMIB with output feedback controller. The first simulation is taken $P \in [-0.2 \ 2.2]$; $Q \in [-0.4 \ 1.8]$ and $X_e \in [-0.4 \ 2.2]$ and $\alpha = 0.002$; $\beta = 0.01$. For this parameters is taken two cases of P, Q, X_e as constant, $p = 1.8$; $Q = 1.2$; $X_e = 1.8$ (Fig. 3-10) and as function $p = 0.8 \sin(t)$; $Q = 0.2 \sin(t)$; $X_e = 0.8 \sin(t)$ (Fig. 10-18).

Figure 3-6 show the performance of design controller of SMIB by using fuzzy pole placement, fuzzy Routh-Hurwitz, LMI and fuzzy LMI. From those figures seem that LMI or Lyapunov function, fuzzy Routh-Hurwitz and the fuzzy LMI output feedback controller give the stable performances. But the fuzzy pole placement give a bad performance of SMIB, the variable δ and ω divergence and there is the overshoot event on E_q and E_{fd} .

Figure 7-10, show the LMI and fuzzy LMI output feedback controller for SMIB. The performance of fuzzy

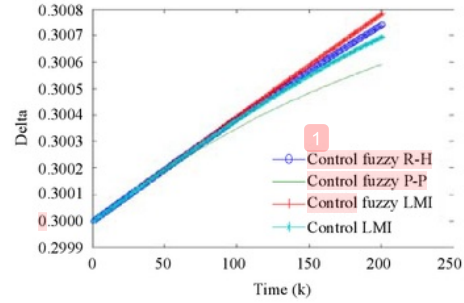


Fig. 3: Performance of δ ($\alpha = 0.002$; $\beta = 0.01$)

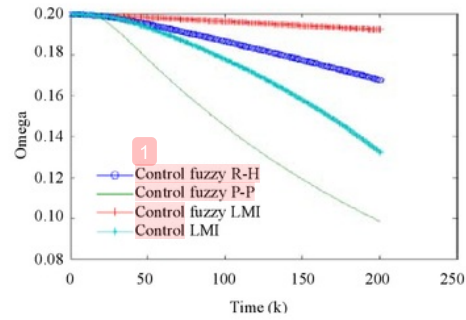


Fig. 4: The performance of ω ($\alpha = 0.002$; $\beta = 0.01$)

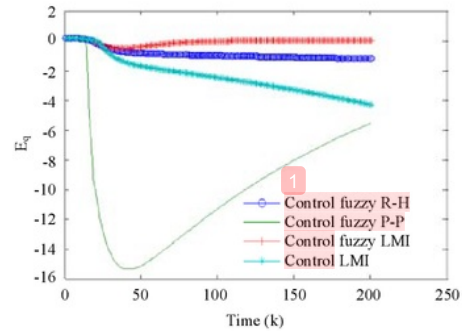


Fig. 5: The performance of E_q ($\alpha = 0.002$; $\beta = 0.01$)

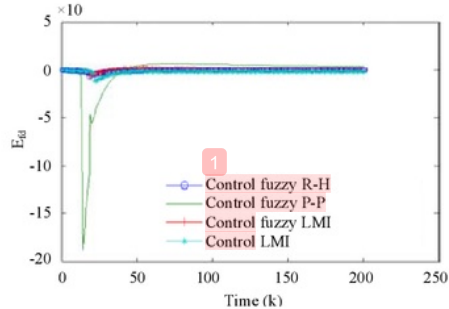


Fig. 6: The performance of E_{fd} ($\alpha = 0.002$; $\beta = 0.01$)

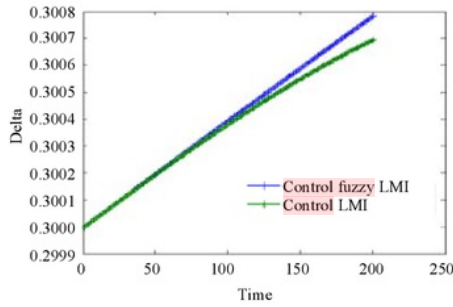


Fig. 7: The performance of δ ($\beta = 0.01$)

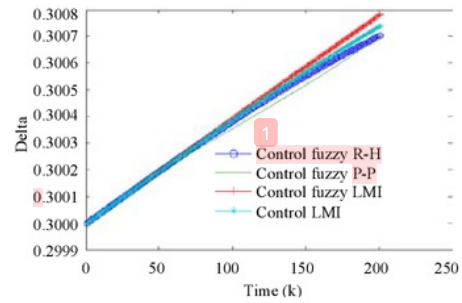


Fig. 11: The performance of δ ($\alpha = 0.002$; $\beta = 0.01$)

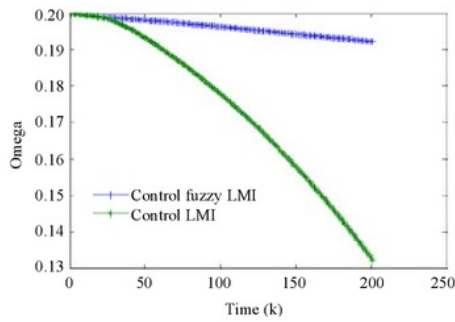


Fig. 8: The performance of ω ($\beta = 0.01$)

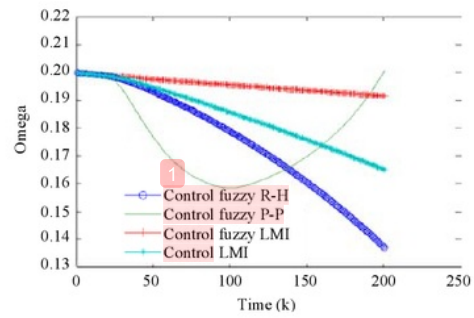


Fig. 12: The performance of ω ($\alpha = 0.002$; $\beta = 0.01$)

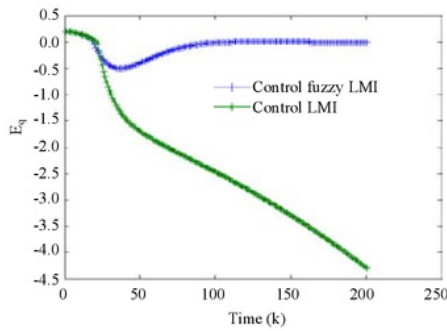


Fig. 9: The performance of E_q ($\beta = 0.01$)

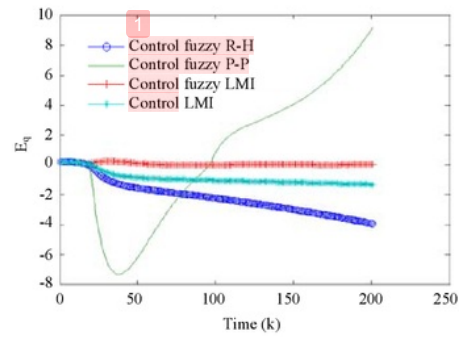


Fig. 13: The performance E_q ($\alpha = 0.002$; $\beta = 0.01$)

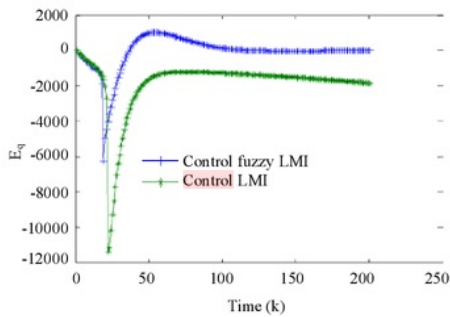


Fig. 10: The performance of E_{δ} ($\beta = 0.01$)

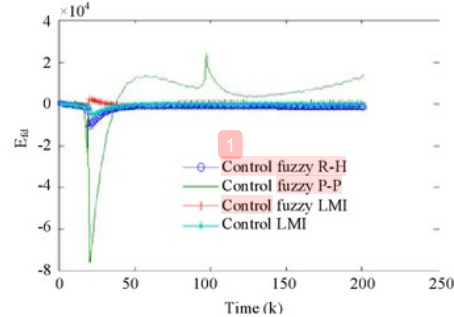


Fig. 14: The performance of E_{δ} ($\alpha = 0.002$; $\beta = 0.01$)

LMI (Lyapunov) output feedback controller give better result than LMI (Lyapunov) output feedback controller for constant P, Q, X_e.

The second simulation, it is applied those methods for the same parameters with dynamical of P; Q; X_e. Suppose, P = 0.8 sin(t); Q = 0.2 sin(t); X_e = 0.8 sin(t). The simulation results are presented as Fig. 11-14.

For P, Q, X_e as dynamical functions the performance of SMIB by using Fuzzy Pole Placement are worst, specially the performance of E_q and E_{ti}. The performance of δ are almost the same as for all methods. The performance of ω, E_q, E_{ti} by using Fuzzy LMI (Lyapunov) has best result than others. The performance of SMIB by using LMI and Fuzzy LMI are presented on Fig. 15-18. The value of angular velocity ω tends to 0.2.

The performance of δ is almost the same between by using the LMI output feedback controller with the Fuzzy output feedback controller (Fig. 15). The performance of ω, E_q by using Fuzzy LMI is more stable than by using LMI (Fig. 16-17). Figure 18 shows that there are the overshooting on the performance of E_{ti}. The overshooting of E_{ti} by using LMI is larger than by using Fuzzy LMI.

In order to define the difference between LMI output feedback controller with LMI Fuzzy output feedback

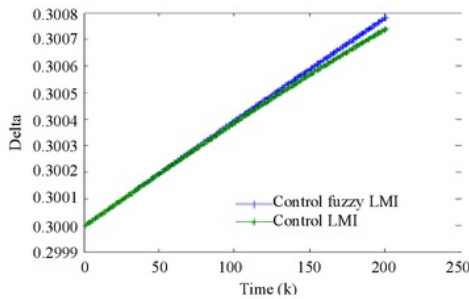


Fig. 15: The performance of δ (β = 0.01)

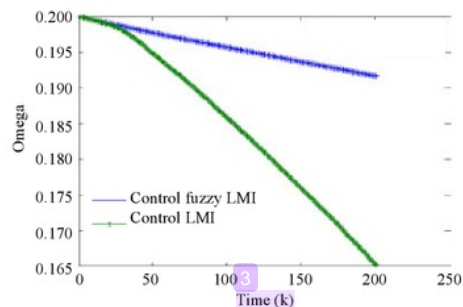


Fig. 16: The performance of ω (β = 0.01)

controller, it has been done the other simulation with different value of β. It taken β = 0.1 and β = 0.5. The performance of δ, ω are almost the same with simulation before (β = 0.01) but the performance of E_q and E_{ti} are different with the simulation with β = 0.01. The results of simulation are presented on Fig. 19-22 for β = 0.1 and Fig. 19-26 for β = 0.5. For β = 0.1, the performance E_q by using Fuzzy LMI is more stable than by using LMI but the performance of E_{ti} has larger overshoot than by using LMI.

For β = 0.5 and P, Q, X_e as constant the performance E_q by using Fuzzy LMI has overshoot and then converge to 0.4. The overshooting of E_q larger than the value of E_q by LMI. But for β = 0.5 and P, Q, X_e as function the performance E_q by using Fuzzy LMI more stable than by using LMI.

For β = 0.5 and P, Q, X_e as constant or as function, the overshooting of E_{ti} by using Fuzzy LMI are larger than by LMI. The performance of E_{ti} by using LMI more stable than by using Fuzzy LMI.

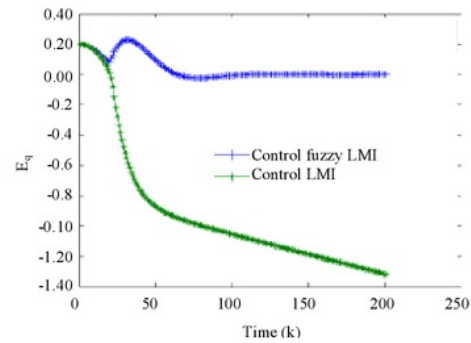


Fig. 17: The performance of E_q (β = 0.01)

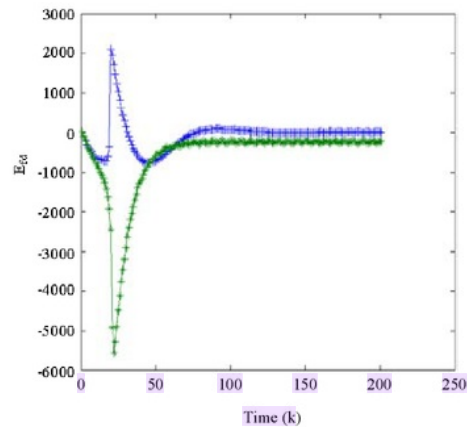


Fig. 18: The performance of E_{ti} (β = 0.01)

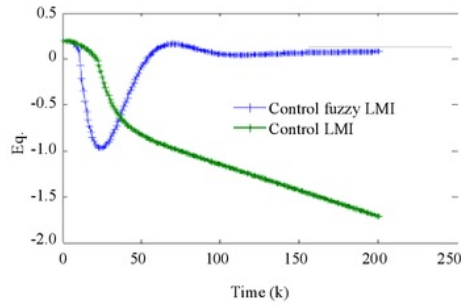


Fig. 19: The performance of E_q for $\beta = 0.1$ P, Q, X_e constant

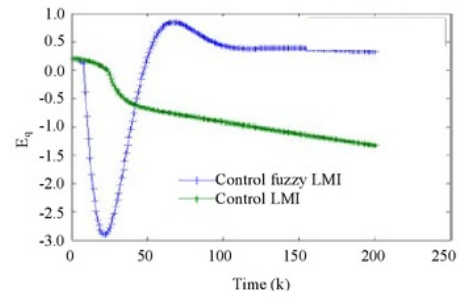


Fig. 23: The performance of E_q for $\beta = 0.5$; P, Q, X_e constant

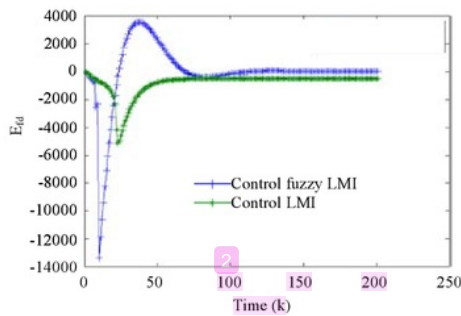


Fig. 20: The performance of E_{id} for $\beta = 0.1$; P, Q, X_e constant

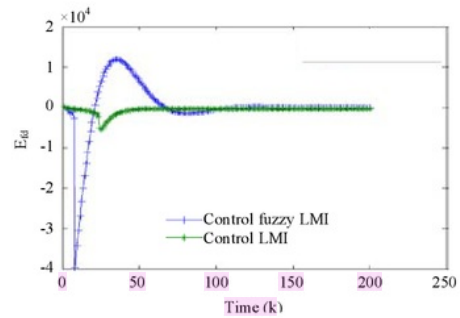


Fig. 24: The performance of E_{id} for $\beta = 0.5$; P, Q, X_e constant

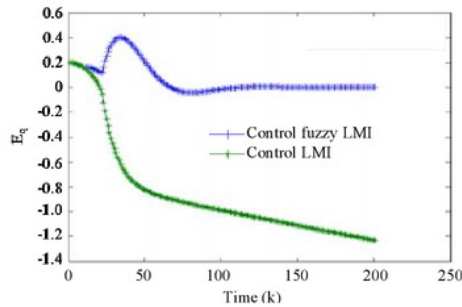


Fig. 21: The performance of E_q for $\beta = 0.1$; P, Q, X_e function

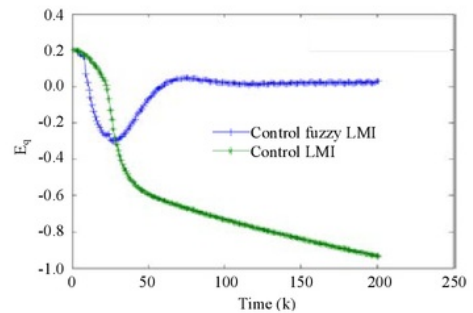


Fig. 25: The performance of E_q for $\beta = 0.5$ P, Q, X_e function

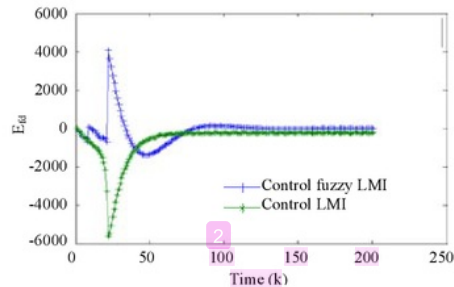


Fig. 22: The performance of E_{id} for $\beta = 0.1$; P, Q, X_e function

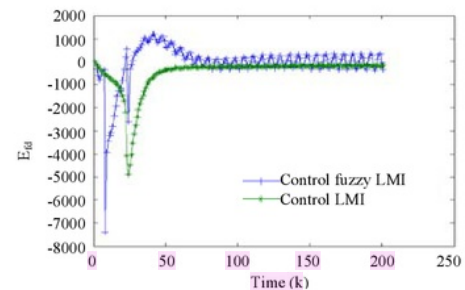


Fig. 26: The performance of E_{id} for $\beta = 0.5$ P, Q, X_e function

CONCLUSION

From the simulation result and discussion, it is conclude that: the fuzzy LMI and LMI output feedback controller have better performance of SMIB than Fuzzy Routh-Hurwitz and Fuzzy Pole Placement. The LMI and Fuzzy LMI output feedback gain:

$$K_1 = \beta \left(\frac{1}{T_E} E_{fd}^i - dE_q^i \right) \frac{T_E}{\omega^j K_E}$$

With $\beta = 0.01$ give better performance than $\beta = 0.5$ and $\beta = 0.5$. The fuzzy LMI output feedback controller is better than LMI output feedback controller, either for P, Q, X_e as constant (P = 0.8; Q = 0.2; $X_e = 0.8$) or as function (P = 0.8 sin (t); Q = 0.2 sin (t); $X_e = 0.8$ sin (t)). The fuzzy LMI output feedback controller is an control design method to enhance the performance of SMIB.

NOMENCLATURE

δ	= Angle
ω	= Angular velocity
E_q	= Induced emf proportional to field current
E_{fd}	= Generator field voltage
ω_0	= Initial angular velocity
T_m	= Mechanical torque
T_E	= Electrical torque
I_q	= Current on the axis q
I_d	= Current on the axis d
x_d	= Generator synchronous reactances
x_d	= The d-axis synchronous reactances
x_q	= The q-axis synchronous reactances
M	= Inertia coefficient
T_{db}	= Open circuit direct axis transient
K_E	= Constant excitation
V_{ref}	= Reference value of generator field voltage
V_T	= Terminal voltage
V_d	= The voltage on the axis d
V_q	= The voltage on the axis q
X_e	= External reactive
P	= Active power
Q	= Reactive power

REFERENCES

- Alfi, A. and M. Khosravi, 2012. Optimal power system stabilizer design to reduce low frequency oscillations via an improved swarm optimization algorithm. *Intl. J. Tech. Phys. Prob. Eng.*, 4: 24-33.
- Ataei, M., R.A. Hooshmand and M. Parastegari, 2012. A wide range robust PSS design based on power system pole-placement using linear matrix inequality. *J. Electr. Eng.*, 63: 233-241.
- Challoshtori, B.B., 2012. Designing robust power system stabilizer using pole placement technique with the aid of LMI. *Intl. J. Nat. Eng. Sci.*, 6: 71-76.
- Jasmitha, D. and R. Vijayasanthi, 2015. Modelling of fuzzy generic power system stabilizer for SMIB system. *Intl. Res. J. Eng. Technol.*, 2: 2327-2335.
- Mondal, D., 2012. PSO based H8 TCSC controller with comparison to its LMI based design in mitigating small signal stability problem. *Intl. J. Electr.*, 1: 28-34.
- Nechad, E., M.N. Harma, N. Essounbouli and A. Hamzaoui, 2013. Adaptive fuzzy sliding mode power system stabilizer using nussbaum gain. *Intl. J. Autom. Comput.*, 10: 281-287.
- Sedaghati, R., A. Rouhani, A. Habibi and A.R. Rajabi, 2014. A novel fuzzy-based power system stabilizer for damping power system enhancement. *Indian J. Sc. Technol.*, 7: 1729-1737.
- Tamaji, T. and I. Robandi, 2017. Routh-Hurwitz and pole placement fuzzy logic control for power system stability improvement. *Intl. Rev. Autom. Control*, 10: 40-48.
- Tanaka, K. and H.O. Wang, 2001. *Fuzzy Control Systems Design and Analysis: A Linear Matrix Inequality Approach*. John Wiley and Sons Inc., New York, USA., ISBN-13: 9780471323242, Pages: 320.
- Yadaiah, N. and N.V. Ramana, 2007. Linearisation of multi-machine power system: Modeling and control a survey. *Intl. J. Electr. Power Energy Syst.*, 29: 297-311.

FUZZY LOGIC BASED ON LYAPUNOV SOLUTION IN POWER SYSTEM STABILITY IMPROVEMENT

ORIGINALITY REPORT

15%

SIMILARITY INDEX

1%

INTERNET SOURCES

15%

PUBLICATIONS

0%

STUDENT PAPERS

PRIMARY SOURCES

- 1** Tamaji Tamaji, Imam Robandi. "Routh Hurwitz and Pole Placement Fuzzy Logic Control for Power System Stability Improvement", International Review of Automatic Control (IREACO), 2017 **11%**
Publication
- 2** Chen, Weisheng, and Xiaobo Li. "Observer-based consensus of second-order multi-agent system with fixed and stochastically switching topology via sampled data : OBSERVER-BASED CONSENSUS OF SECOND-ORDER MULTI-AGENT SYSTEM", International Journal of Robust and Nonlinear Control, 2012. **3%**
Publication
- 3** idea.library.drexel.edu **1%**
Internet Source

Exclude bibliography Off

FUZZY LOGIC BASED ON LYAPUNOV SOLUTION IN POWER SYSTEM STABILITY IMPROVEMENT

GRADEMARK REPORT

FINAL GRADE

/0

GENERAL COMMENTS

Instructor

PAGE 1

PAGE 2

PAGE 3

PAGE 4

PAGE 5

PAGE 6

PAGE 7

PAGE 8

PAGE 9
